


591.119
DRAWING NUMBER
CA 1101
E-2 #1
A-105

DRAWING NUMBER
CA 1101
E-2 #1

DRAWING NUMBER
CA 1101
E-2 #1

DRAWING NUMBER
CA 1101
E-2 #1

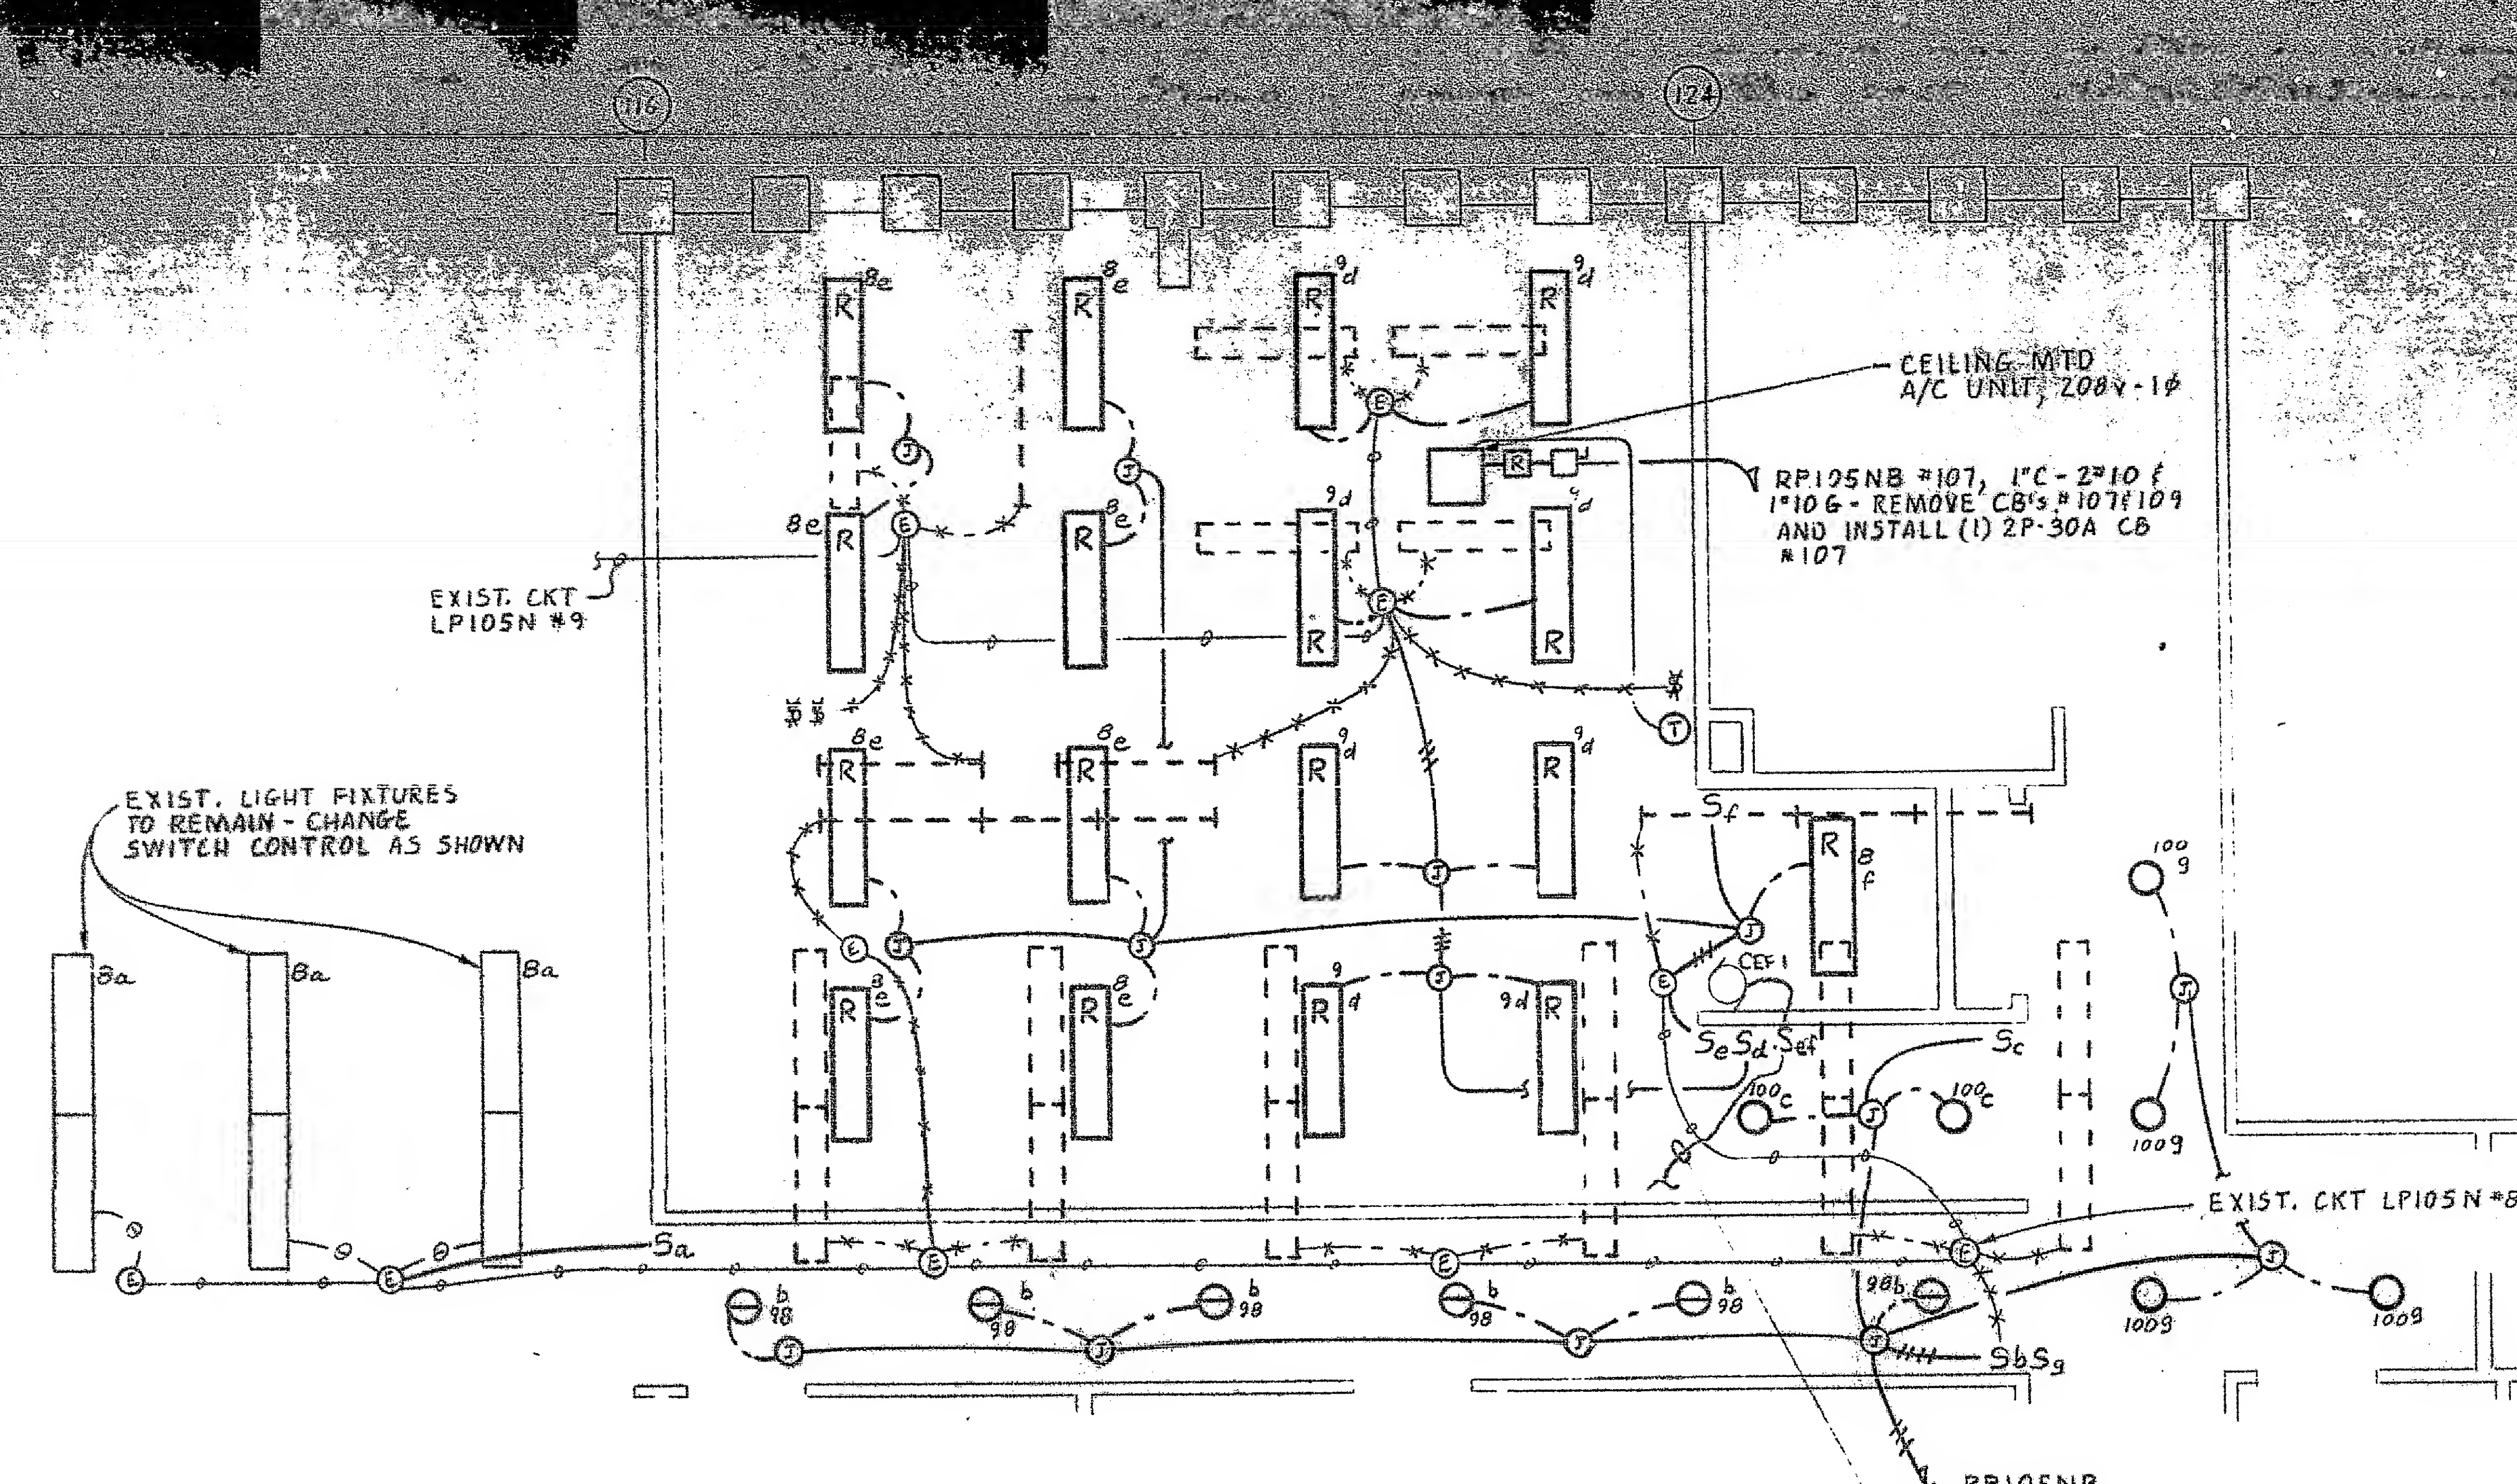

LIGHTING PLAN
SCALE: 1/4" = 1'-0"

- LEGEND**
- EXISTING STRIP LIGHT TO BE REMOVED
 - EXISTING 1'x4' FLUORESCENT FIXTURE TO REMAIN
 - EXISTING 1'x4' FLUORESCENT FIXTURE TO BE RELOCATED
 - EXISTING 1'x4' FLUORESCENT FIXTURE*
 - ⊖ RECESSED WALL WASHER - 100 W
 - RECESSED DOWN LIGHT - 100 W
 - ⊕ EXISTING JUNCTION BOX TO REMAIN
 - ⊙ JUNCTION BOX
 - ⊗ EXISTING SWITCH TO BE REMOVED
 - S SINGLE POLE TOGGLE SWITCH 20A-277V. WALL MTD 50" AFF. HUBBELL #H21-GRAY, OR 15A-125V #H01-GRAY. LETTER DENOTES CONTROL.
 - EXISTING CONDUIT & WIRING TO REMAIN
 - **** REMOVE EXISTING CONDUIT & WIRING
 - RIGID STEEL CONDUIT (U.L. STD #6) RUN CONCEALED
 - EXISTING FLEXIBLE CONDUIT & CABLE CONNECTION TO REMAIN
 - REMOVE EXISTING FLEXIBLE CONDUIT & CABLE CONNECTION
 - FLEXIBLE CONDUIT & CABLE CONNECTION (U.L. STD #14)
 - HOMERUN TO PANEL INDICATED. MINIMUM SIZE 1" CDT.
 - 2" 1/4 TEFLON SMOKE DETECTION WIRING
 - F FLEXIBLE CONDUIT - MINIMUM SIZE 3/4"
 - UF ⊕ SMOKE DETECTOR - UF DENOTES UNDERFLOOR MOUNTED
 - ⊕ THERMOSTAT
 - ⊕ KEY OPERATED SWITCH WALL MOUNTED 50" AFF, 15A-125V HUBBELL #H01-L
 - ⊕ EXISTING RECEPTACLE TO REMAIN
 - ⊕ REMOVE EXISTING RECEPTACLE
 - ⊕ WALL MOUNTED RECEPTACLE 15A-125V HUBBELL #5262
 - ⊕ DUPLEX RECEPTACLE MOUNTED ON WIREMOLD HUBBELL #5262
 - ⊕ KEY SWITCH CONTROLLED DUPLEX RECEPTACLE MOUNTED ON WIREMOLD HUBBELL #5262
- SEE DWG 105F #4 FOR FIXTURE SCHEDULE AND SPECS.

- LEGEND (CONT'D)**
- ⊕ KEY-SWITCH CONTROLLED DUPLEX RECEPTACLE - 15A-125V HUBBELL #5262
 - ⊕ OPENING IN RAISED FLOOR FOR WIRING TO TRADING DESK
 - ⊕ FLOOR MOUNTED DUPLEX RECEPTACLE SPLIT-WIRED FOR (2) 20A-125V CIRCUITS HUBBELL #5362. CONNECT TO FLOOR CELL WITH CDT & AFTERSET FITTING. (SEE NOTE #1 FOR AFTERSET FITTING)
 - ⊕ FLOOR MTD COMBINATION TEL/DUPLEX RECEPTACLE TO BE REMOVED. REMOVE AFTERSET FITTING AND PLUG SLAB.
 - PLUGMOLD, SIZE AS INDICATED, LENGTH AS INDICATED, WITH SINGLE RECEPTS 15A-125V SPACED AS INDICATED.
 - ▶ WALL MOUNTED TELEPHONE OUTLET - CONNECT TO FLOOR CELL WITH CONDUIT AND AFTERSET FITTING (SEE NOTE #1 FOR AFTERSET FITTING)
 - ▶ TELEPHONE JACK MOUNTED TO UNDERSIDE OF TRADING DESK - PROVIDED & INSTALLED BY I.P.C.
 - ▶ 40 LINE TELEPHONE TURRET BUILT INTO TRADING DESK I.P.C. MODULAR SERIES II
 - CEF CEILING EXHAUST FAN
 - Sef WALL SWITCH W/ PLUG LT FOR CEF